

TYPICAL WALL TYPE NOTES

GENERAL NOTE APPLICABLE TO ALL DRAWINGS: ITEMS AND CONDITIONS DETAILED NOTED OR OTHERWISE IDENTIFIED ON ONE OF THE SECTIONS OR DETAILS ARE APPLICABLE AND BINDING TO ALL OTHER SECTIONS AND DETAILS FOR IDENTICAL OR SIMILAR CONDITIONS.

- NOT ALL WALL TYPES ARE REPRESENTED IN THIS PROJECT.
- WALLS SHALL EXTEND FULL HEIGHT FROM FLOOR SLAB TO THE FLOOR OR ROOF DECK ABOVE UNLESS SPECIFICALLY NOTED OTHERWISE. IN CORRIDORS, EXTEND COLUMN CHASE AND LOCKER FIN WALLS 4" ABOVE CEILING ONLY.
- REFER TO THE CODE STUDY AND FLOOR PLANS FOR IDENTIFICATION OF ALL SMOKE AND FIRE WALL LOCATIONS. IN ADDITION TO THE REQUIREMENTS INDICATED ON THE CODE STUDY AND FLOOR PLANS, ALL CORRIDOR AND VESTIBULE WALLS SHALL BE SEaled TO RESIST THE PASSAGE OF SMOKE.
- FIRE WALLS: FIRE SEPARATION WALLS, SMOKE BARRIER WALLS AND WALLS REQUIRED TO RESIST THE PASSAGE OF SMOKE SHALL EXTEND FULL HEIGHT FROM FLOOR SLAB TO THE FLOOR OR ROOF DECK ABOVE AND SHALL BE SEALED TO THE DECK OR STRUCTURAL MEMBER WITH AN APPROVED FIRE RESISTIVE JOINT SYSTEM. SEAL ALL PENETRATIONS AND TOPS OF WALLS IN ACCORDANCE WITH SPECIFICATION DIVISION 8 SECTION - FIRE RESISTIVE JOINT SYSTEM. WALLS AT FIRE AND SMOKE CONDITIONS LOCATIONS LISTED ABOVE SHALL BE BUILT TO MATCH TOUSERS, FRAMES AND PENETRATIONS AND SHALL BE TERMINATED IN ACCORDANCE WITH WALL TERMINATION DETAILS ON THIS SHEET. ALL FLUTES IN FLOOR AND ROOF DECKS AS INDICATED, WHERE WALLS AT FIRE AND SMOKE CONDITIONS LOCATIONS LISTED ABOVE ARE INTERRUPTED BY STRUCTURAL MEMBERS, PROVIDE FIRE RESISTIVE JOINT SYSTEM IN AREAS BETWEEN TOP AND/OR SIDE OF WALL AND STRUCTURAL MEMBER AND BETWEEN SIDE AND/OR STRUCTURAL MEMBER IN ACCORDANCE WITH APPROVED FIRE RESISTIVE JOINT SYSTEM AND TYPICAL WALL TERMINATION NOTE H BELOW.
- SEE WALL SECTIONS AND DETAILS FOR EXTERIOR WALL TYPES.
- THESE WALL TYPES ARE GENERAL IN NATURE AND DO NOT COVER EVERY VARIATION THAT MAY OCCUR THROUGHOUT THE PROJECT. SEE WALL SECTIONS AND DETAILS FOR ADDITIONAL INFORMATION.
- TYPICAL CMU INTERIOR PARTITION SHALL BE TYPE A2 UNLESS INDICATED OTHERWISE BY WALL TYPE SYMBOLS, WALL SECTIONS OR OTHER DETAILS.
- TYPICAL GYPSUM BOARD STUD WALL PARTITION SHALL BE TYPE J1 UNLESS INDICATED OTHERWISE BY WALL TYPE SYMBOLS, WALL SECTIONS OR OTHER DETAILS.
- WALL TYPES MAY NOT HAVE BEEN INCLUDED IN THIS SCHEDULE FOR INTERIOR WALL TYPES WHICH ARE COVERED BY WALL SECTIONS.
- THESE WALL TYPES DO NOT SHOW LATERAL BRACING OR WALL REINFORCING. SEE STRUCTURAL AND OTHER DRAWINGS FOR THAT INFORMATION.
- SEE FINISH SCHEDULE FOR FINISHES TO BE APPLIED TO THESE WALL TYPES.
- ALL WALLS WITH FIRE RATING INDICATED SHALL BE BUILT IN STRICT CONFORMANCE WITH A UL TESTED ASSEMBLY OR OTHER TESTED ASSEMBLY WHICH PROVIDES THE FIRE RATING INDICATED.
- FURRING CHANNELS AND STUDS SHALL BE 18" O.C. MAXIMUM UNLESS SPECIFICALLY NOTED OTHERWISE.
- THE CASE OF ALL METAL STUDS SHALL BE THE FULL SECTION OF THE WALL SHALL NOT EXCEED 1045 PER ASTM C645 UNLESS A HEAVIER GAGE IS INDICATED ON THE WALL TYPE OR DETAILS.
- ALL WALLS WITH SOUND ATTENUATION BLANKETS OR AN ACOUSTIC LAYER OR OUTLETS, SWITCHES, ETC., SHALL NOT BE LOCATED BACK TO BACK. OUTLETS SHALL BE OFFSET AND SEALED. PERIMETERS OF WALLS AT ADJACENT WALLS, COLLARS, CEILING, ETC., SHOULD BE SEALED. ADDITIONAL WALL PENETRATIONS SHALL BE SEALED WITH APPROPRIATE TYPE OF ACOUSTIC SEALANT.
- PROVIDE SPACE FOR DEFLECTION OF BEAMS, JOISTS, AND STEEL DECK @ TOP OF ALL WALLS THAT RUN TO THE DECK. FILL GAP WITH NON-COMBUSTIBLE, COMPRESSIBLE FILLER ON NON RATED WALLS AND APPROVED FIRE SAFETY ON RATED WALLS. SEE TYPICAL DETAILS THIS SHEET.
- FOR CASES WHEN WALLS ARE INDICATED TO EXTEND FULL HEIGHT TO THE DECK BUT STOP AT A STRUCTURAL MEMBER, SEE THE TYPICAL DETAILS ON SHEET A205 FOR THE APPROPRIATE CLOSURE CONDITION - EXACT CONDITION IS NOT INDICATED.
- PROVIDE 2" HIGH X 18 GA. X LENGTH REQUIRED STEEL PLATE BLOOMING OR 2" FRT HD BLOCKING IN ALL IN ALL STUD WALLS WHERE REQUIRED TO ATTACH LOCKERS, CABINETS, SHELVING, LIGHTS, ELECTRICAL DEVICES, TOILET ACCESSORIES AND ANY OTHER ITEM WHICH REQUIRE SECURE ATTACHMENT TO THE WALLS.
- ROOMS WHERE NO FINISH CEILING IS PROVIDED, EXTEND ALL CHASE WALLS TO FLOOR OR ROOF DECK ABOVE.
- PROVIDE CONT. SEALANT AT BASE OF ALL GYP. BD. WALLS (BOTH SIDES) TYPICAL.
- WHERE MARKET STONE AND/OR CERAMIC TILE IS SCHEDULED FOR WALL, USE PORTLAND CEMENT TILE BACKER BOARD IN LIEU OF GYPSUM BOARD.
- IN TOILET ROOMS, JANITOR CLOSETS, AND KITCHEN SPACES, PROVIDE WATER RESISTANT GYPSUM WALL BOARD. REFER TO SPECIFICATIONS.

HARTMAN-COX ARCHITECTS
1074 Thomas Jefferson St., NW
Washington, DC 20007
202.333.6444

GRIMM AND PARKER
11720 Baltville Drive
Suite 600
Calverton, MD 20705
301.595.1000


Project Name:
Program Managers
Architect:
SK & A Structural Engineers, PLLC
Mechanical:
WSP | Associates International
Electrical:
Wilms Mosch Corporation DC
Interior Finish:
Shapiro 20
Acoustics:
Polytonics
Insulation:
Nytron Associates

DGS CONTRACT NO. YY187C

DISTRICT OF COLUMBIA PUBLIC SCHOOLS

HCA# 1409 GP# 21442

SPECIAL WALL TYPE NOTES

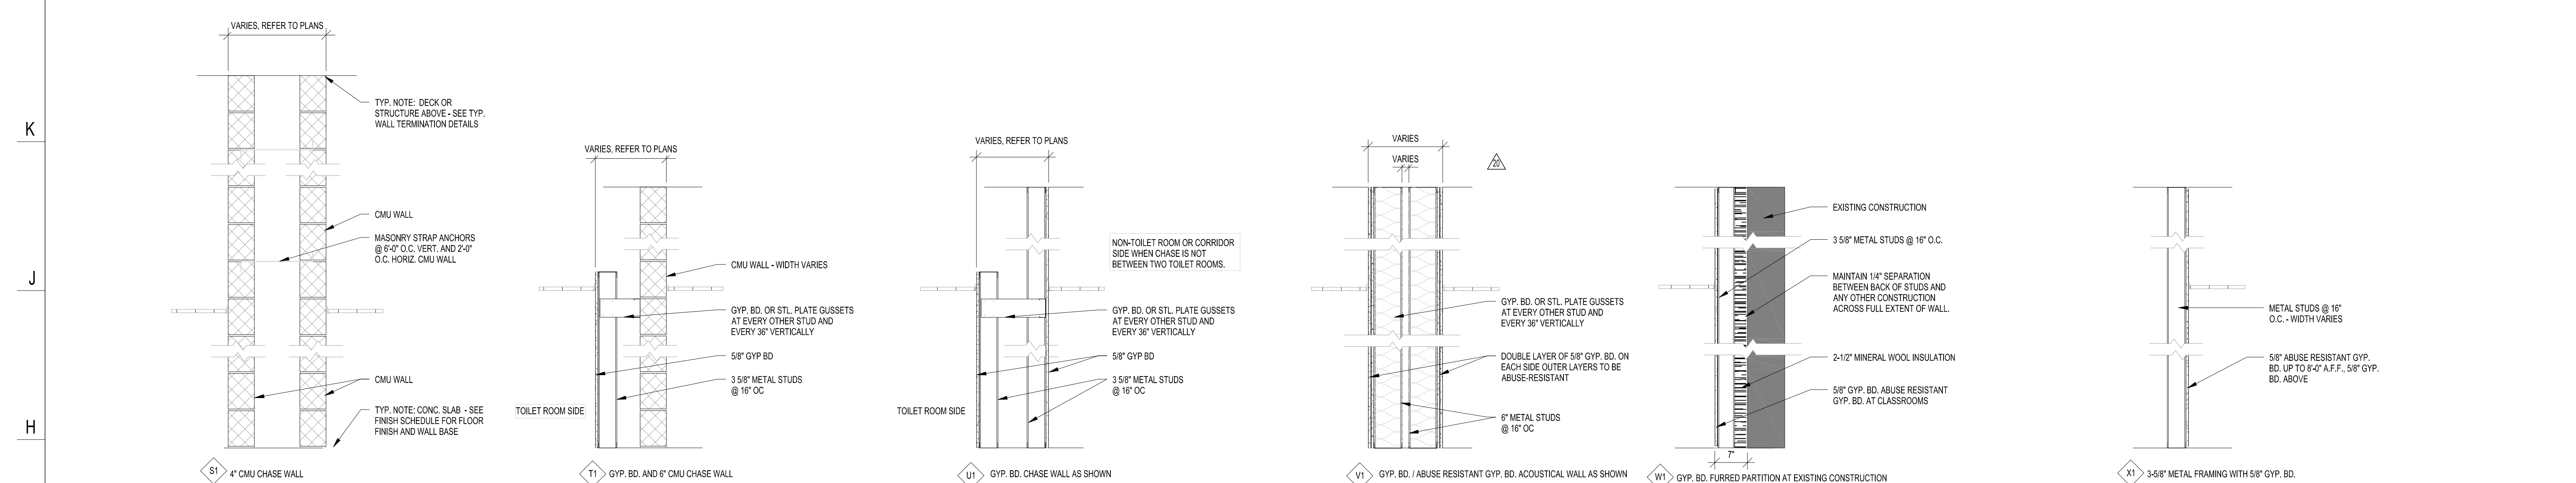

ELECTRICAL BOXES IN FIREWALLS

ELECTRICAL BOXES IN FIRE RATED PARTITIONS SHALL NOT EXCEED 16 SQUARE INCHES IN AREA (IF ANY), SHALL BE MADE OF STEEL, AND SHALL BE SPACED SUCH THAT THE CUMULATIVE AREA OF BOX CUTOUTS IN THE ORIGINAL DOES NOT EXCEED 100 SQUARE INCHES PER 100 SQUARE FEET OF WALL AREA. ELECTRICAL BOXES ON OPPOSITE SIDES OF THE SAME FIREWALL SHALL BE SEPARATED BY A HORIZONTAL AND VERTICAL DISTANCE OF NOT LESS THAN 24\"/>

TYPICAL WALL TERMINATION NOTES

1. USE TYPICAL WALL TERMINATION DETAILS SHOWN ON A105 FOR ALL WALLS INDICATED TO EXTEND TO DECK ABOVE, UNLESS SPECIFICALLY DETAILED OTHERWISE. COORDINATE WITH STRUCTURAL FRAMING PLANS.
2. SEE WALL TYPES ABOVE FOR ACTUAL WALL CONSTRUCTION.
3. AT FIRE WALLS, FIRE SEPARATION WALLS, SMOKE BARRIER WALLS AND WALLS REQUIRED TO RESIST THE PASSAGE OF SMOKE, ALL COMPRESSIBLE, NON-COMBUSTIBLE MATERIALS REFERENCED IN WALL TERMINATION DETAILS SHALL BE INTERNALS PROVIDED IN ACCORDANCE WITH THE APPROVED FIRE RESISTIVE JOINT SYSTEM.
4. IF A WALL REQUIRING A FIRE RATING IS LOCATED DIRECTLY UNDER A BEAM, THE FIRE RATING OF THE WALL SHALL BE MAINTAINED TO THE DECK BY EXTENDING WALL AROUND BEAM. CONSULT ARCHITECT FOR EXACT REQUIREMENTS TO MAINTAIN RATING.



PARTITION SCHEDULE
LAFAYETTE ELEMENTARY
WASHINGTON, DC

SUBMISSION	
DATE	DESCRIPTION
7.17.15	CONSTRUCTION SET
REVISION	
DATE	REVISION NO.
10.15	ADDENDUM 1
12.11.15	ADDENDUM 2
12.18.15	ADDENDUM 21